
Vital Input Panel (Wireframe)

Screen Navigation : ER / OP/ IP module > Vitals > Add New Vitals


Requirement No 1 — Rearrange Vitals Panel Layout (From **Old layout** to **New layout**)

Old layout : as shown in below

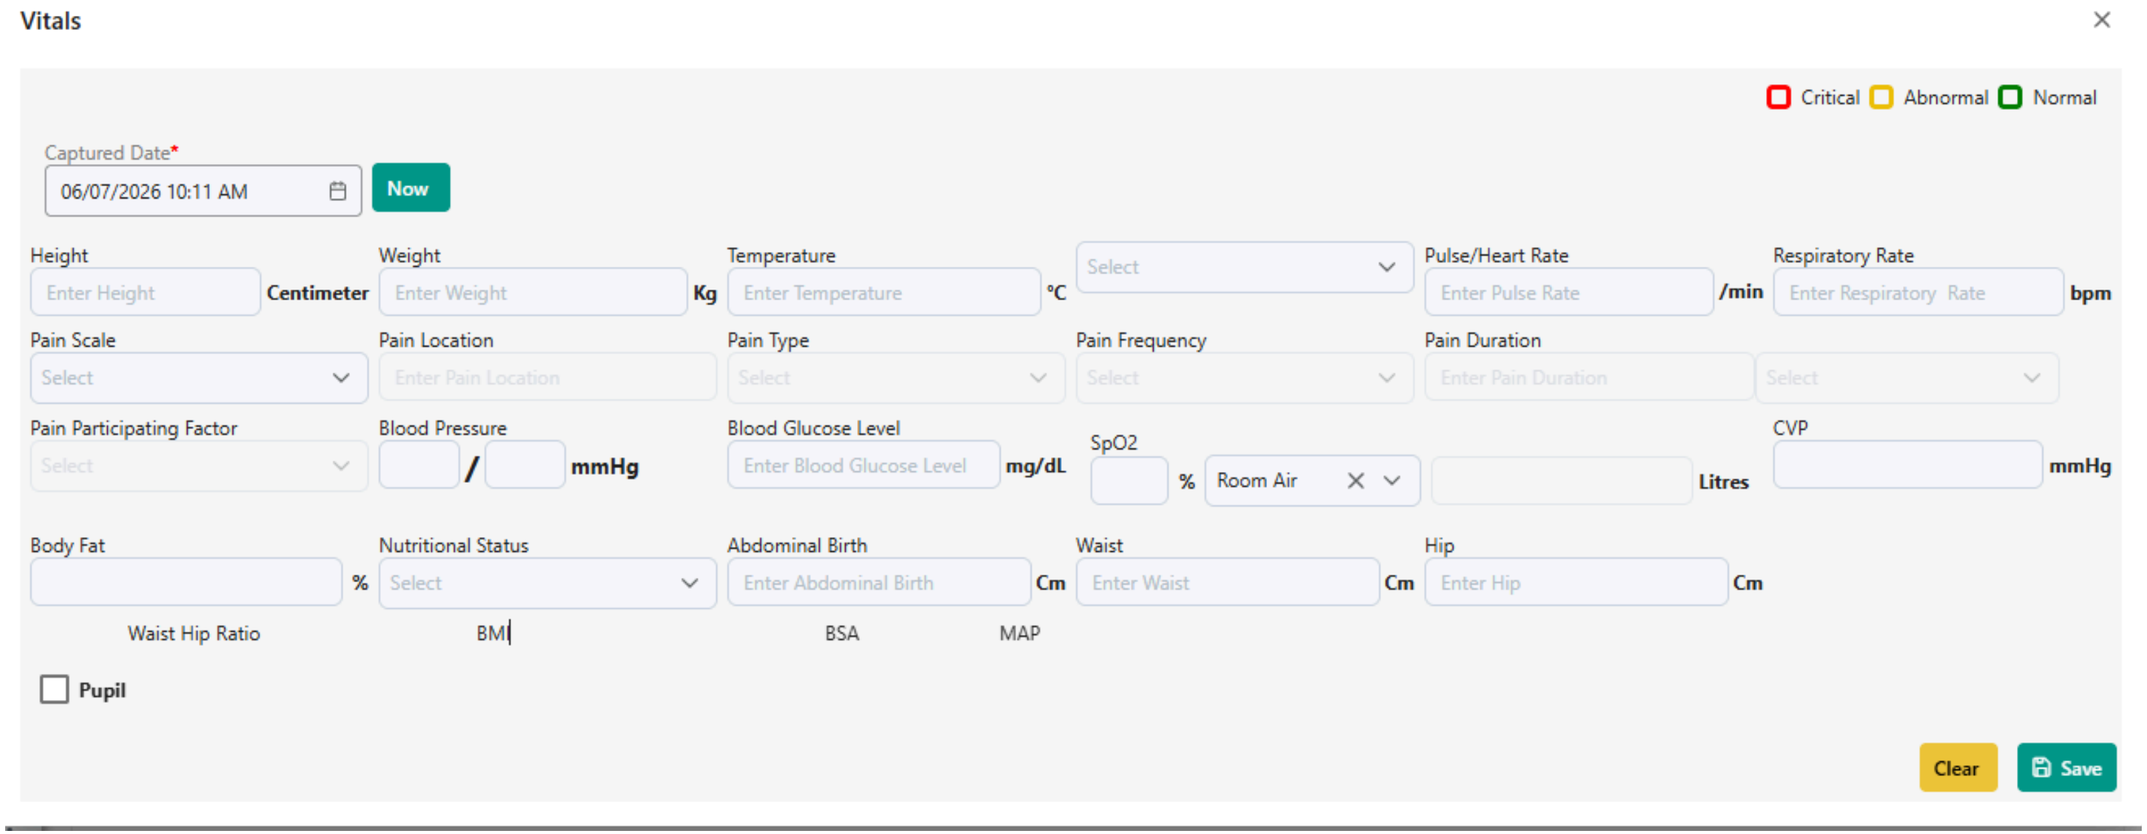

New layout:

- Panel split into 2 groups : Vital Signs (top) and Anthropometry & Other Measurements (bottom).

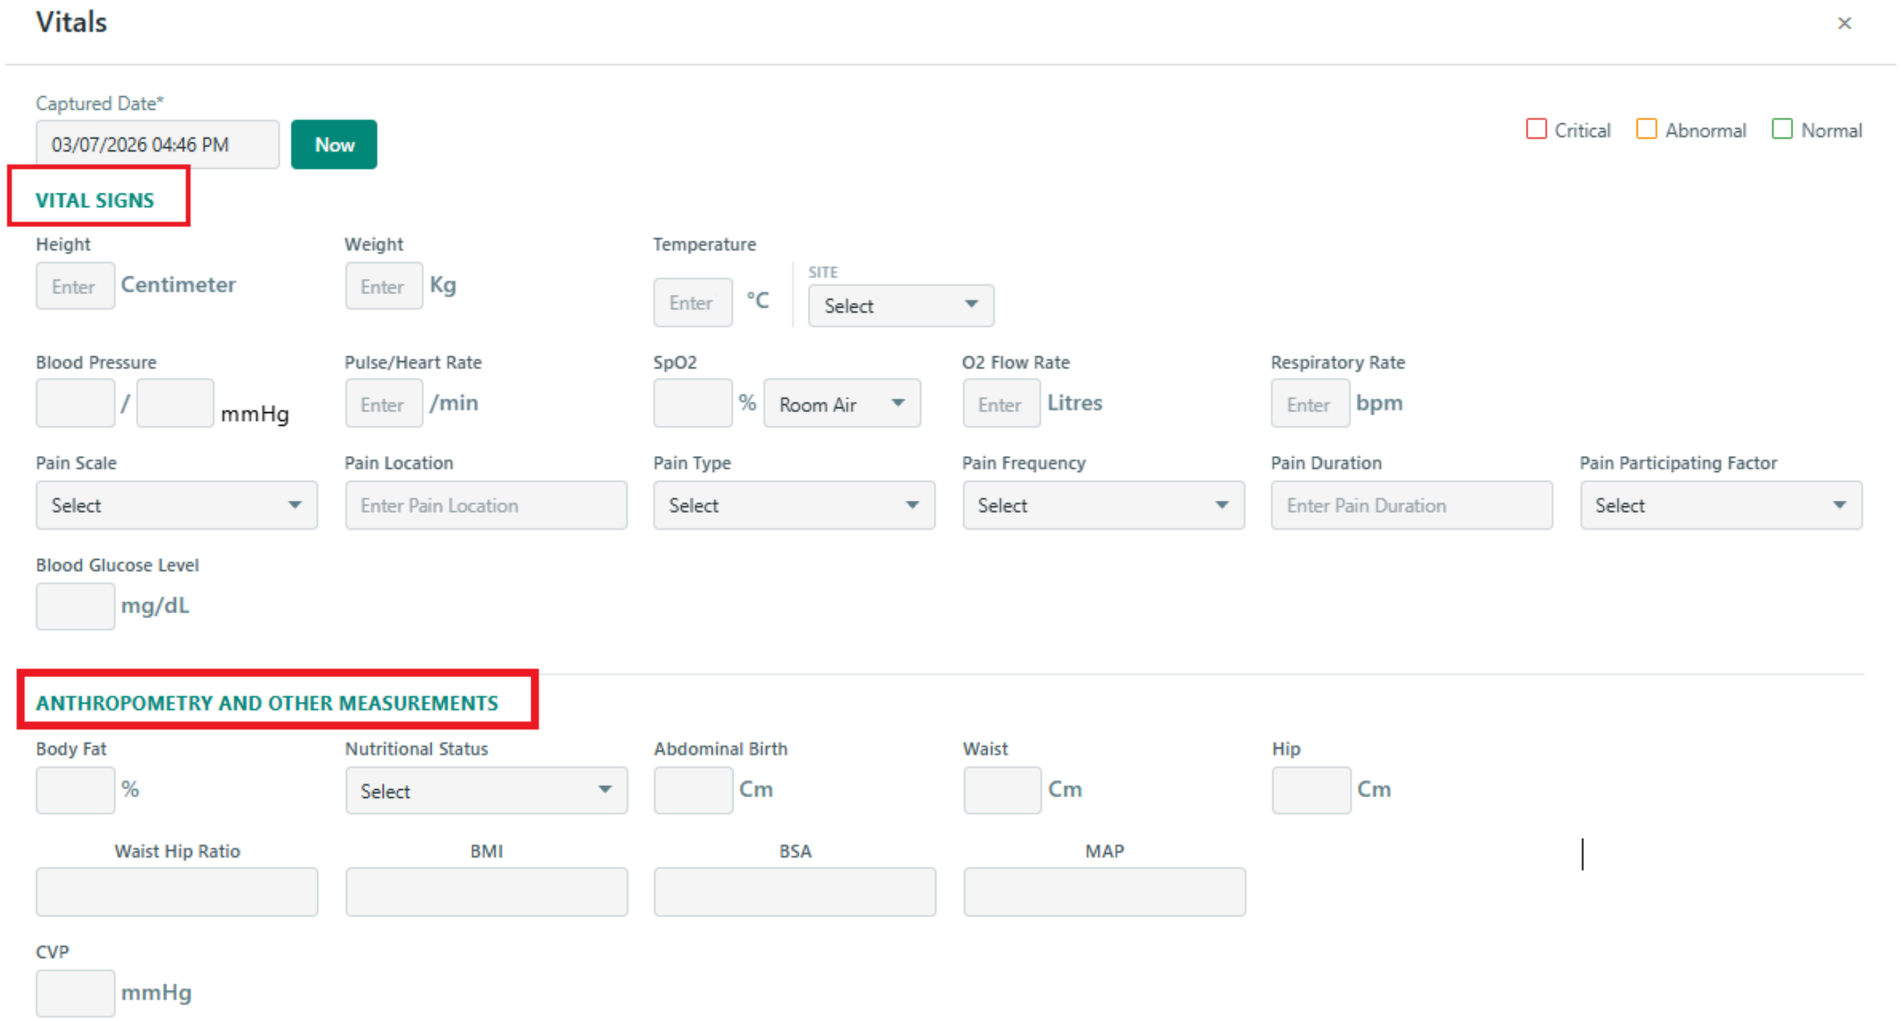

Requirement No 2 - Add New Specialty Assessment Sections

2.1 Visual Acuity Test Section

- Placement: Add a new card container directly below the "Anthropometry and Other Measurements" section.

2.2 Weber + Rinne Test (ENT) Section

- Placement: Add a card container directly below the new Visual Acuity Test section.

Visual Acuity Test STANDARD

2.1 Visual Acuity Test Section

Test Condition

○ With Glasses ○ Without Glasses

Right Eye (OD)

6 / 6 ☐ Unable to Assess

Left Eye (OS)

6 / 6 ☐ Unable to Assess

Weber + Rinne Test (ENT) STANDARD

2.2 Weber + Rinne Test (ENT) Section

Weber Test

○ Midline ○ Lateralized Right ○ Lateralized Left

Rinne Test

RIGHT EAR

○ Positive (AC > BC) ○ Negative (BC ≥ AC)

LEFT EAR

○ Positive (AC > BC) ○ Negative (BC ≥ AC)

Impression (optional)

○ Normal ○ Conductive hearing loss ○ Sensorineural hearing loss ○ Mixed hearing loss

☐ Pupil

Clear Save

Final Expected Output of Vital Signs Panel

